

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221512

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221512
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 2436 LIGHT ENGINE, WHITE SHADE, NARROW DISTRIBUTION.
LIGHT LEVEL 2 - 32,000 LUMENS
Light Source: 5000K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 28607.7 lumens
Efficiency: N/A
Efficacy: 148.1 lumens/watt
Spacing Criteria (0/90/45): 1.05 / 1.05 / 1.01
Luminous Opening: Vertical Cylinder (Dia: 1.54' x H: 0.71')
CIE Type: Direct

Input Watts (W): 193.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

Luminous Intensity Polar Plot

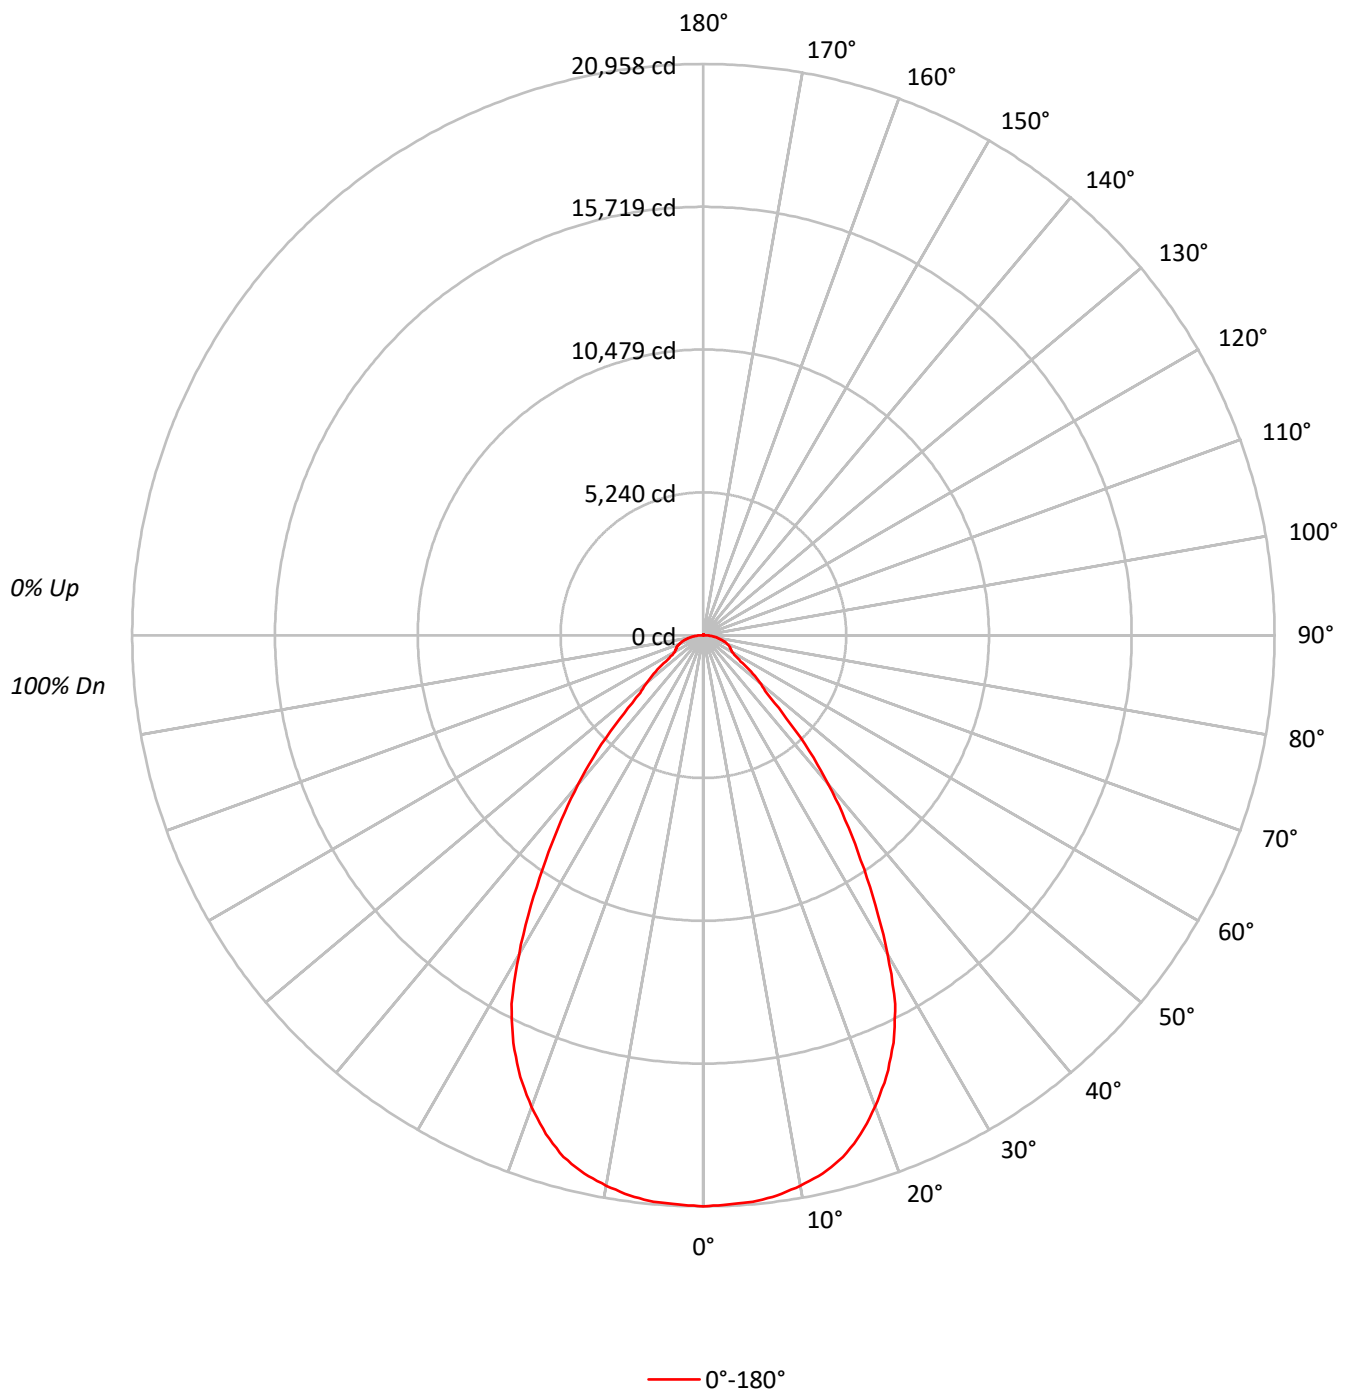

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	112	108	105	102		109	106	103	100		102	99	97		98	96	94		94	93	91
2	104	98	93	89		102	96	92	88		93	89	86		90	87	84		87	84	82
3	98	90	83	79		95	88	82	78		85	80	76		83	79	75		80	77	74
4	91	82	75	70		89	81	75	70		79	73	69		76	72	68		74	70	67
5	86	76	69	63		84	75	68	63		73	67	62		71	66	62		69	65	61
6	81	70	63	58		79	69	62	58		68	62	57		66	61	57		65	60	56
7	76	65	58	53		74	64	57	53		63	57	52		61	56	52		60	55	52
8	72	60	53	49		70	60	53	49		59	53	48		57	52	48		56	51	48
9	68	56	50	45		66	56	49	45		55	49	45		54	48	45		53	48	44
10	64	53	46	42		63	52	46	42		52	46	42		51	45	41		50	45	41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	120854
5°	114928
10°	108875
15°	102302
20°	93173
25°	82498
30°	67363
35°	50288
40°	36103
45°	22203
50°	14254
55°	9152
60°	6951
65°	6574
70°	6009
75°	5126
80°	3937
85°	2287

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 22203 cd/sqm

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1980.7	6.9
10°-20°	5548.7	19.4
20°-30°	7488.6	26.2
30°-40°	6317.8	22.1
40°-50°	3462.7	12.1
50°-60°	1601.8	5.6
60°-70°	1068.5	3.7
70°-80°	769.3	2.7
80°-90°	285.3	1.0
90°-100°	7.9	0.0
100°-110°	8.5	0.0
110°-120°	9.0	0.0
120°-130°	9.5	0.0
130°-140°	11.7	0.0
140°-150°	15.1	0.1
150°-160°	12.8	0.0
160°-170°	7.2	0.0
170°-180°	2.6	0.0
0°-30°	15017.9	52.5
0°-40°	21335.7	74.6
0°-60°	26400.2	92.3
0°-90°	28523.3	99.7
90°-120°	25.4	0.1
90°-150°	61.8	0.2
90°-180°	84.0	0.3
0°-180°	28607.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	20958	
5°	20871	###
15°	19823	5549
25°	16504	7489
35°	10070	6318
45°	4315	3463
55°	1671	1602
65°	1086	1069
75°	732	769
85°	266	266
90°	7	21
95°	7	6
105°	8	9
115°	9	9
125°	10	10
135°	14	12
145°	25	15
155°	28	13
165°	26	7
175°	28	3
180°	31	

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	20958.5
2.5°	20910.3
5°	20871.3
7.5°	20735.9
10°	20512.3
12.5°	20233.3
15°	19823.0
17.5°	19200.4
20°	18416.7
22.5°	17548.9
25°	16503.6
27.5°	15245.0
30°	13534.0
32.5°	11760.5
35°	10070.0
37.5°	8553.9
40°	7150.6
42.5°	5767.9
45°	4315.4
47.5°	3138.9
50°	2696.7
52.5°	2213.6
55°	1671.0
57.5°	1362.2
60°	1213.5
62.5°	1141.7
65°	1086.3
67.5°	1013.5
70°	929.3
72.5°	837.0
75°	732.4
77.5°	624.7
80°	511.9
82.5°	392.9
85°	265.7
87.5°	130.3
90°	7.2
92.5°	7.2
95°	7.2
97.5°	7.2
100°	7.2
102.5°	8.2
105°	8.2
107.5°	8.2
110°	8.2

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

CANDELA DISTRIBUTION (continued):

	0°
112.5°	9.2
115°	9.2
117.5°	9.2
120°	9.2
122.5°	10.3
125°	10.3
127.5°	11.3
130°	12.3
132.5°	13.3
135°	14.4
137.5°	17.4
140°	19.5
142.5°	21.5
145°	24.6
147.5°	26.7
150°	28.7
152.5°	28.7
155°	27.7
157.5°	26.7
160°	25.6
162.5°	24.6
165°	25.6
167.5°	25.6
170°	26.7
172.5°	26.7
175°	27.7
177.5°	28.7
180°	30.8

TEST NUMBER: P1221512

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-WHTE-08 (5000K_L32_Narrow_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.95	16.19	15.32	16.51	16.83	14.95	16.19	15.32	16.51	16.83
	3H	16.81	17.91	17.20	18.25	18.62	16.81	17.91	17.20	18.25	18.62
	4H	17.53	18.56	17.94	18.92	19.31	17.53	18.56	17.94	18.92	19.31
	6H	18.05	19.00	18.47	19.37	19.78	18.05	19.00	18.47	19.37	19.78
	8H	18.21	19.10	18.64	19.50	19.91	18.21	19.10	18.64	19.50	19.91
	12H	18.29	19.15	18.73	19.53	19.97	18.29	19.15	18.73	19.53	19.97
4H	2H	15.45	16.48	15.86	16.84	17.23	15.45	16.48	15.86	16.84	17.23
	3H	17.52	18.36	17.94	18.77	19.18	17.52	18.36	17.94	18.77	19.18
	4H	18.35	19.11	18.79	19.54	19.99	18.35	19.11	18.79	19.54	19.99
	6H	18.99	19.65	19.46	20.10	20.57	18.99	19.65	19.46	20.10	20.57
	8H	19.18	19.80	19.66	20.25	20.73	19.18	19.80	19.66	20.25	20.73
	12H	19.30	19.84	19.79	20.33	20.81	19.30	19.84	19.79	20.33	20.81
8H	4H	18.59	19.20	19.06	19.65	20.13	18.59	19.20	19.06	19.65	20.13
	6H	19.33	19.83	19.84	20.33	20.82	19.33	19.83	19.84	20.33	20.82
	8H	19.59	20.04	20.12	20.56	21.06	19.59	20.04	20.12	20.56	21.06
	12H	19.77	20.16	20.29	20.67	21.24	19.77	20.16	20.29	20.67	21.24
12H	4H	18.59	19.13	19.08	19.62	20.10	18.59	19.13	19.08	19.62	20.10
	6H	19.36	19.81	19.88	20.33	20.83	19.36	19.81	19.88	20.33	20.83
	8H	19.66	20.06	20.18	20.56	21.14	19.66	20.06	20.18	20.56	21.14