

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221382

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221382
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-23)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 2436 LIGHT ENGINE, BLACK SHADE, MEDIUM DISTRIBUTION.
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source: 6500K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18522.6 lumens
Efficiency: N/A
Efficacy: 119.8 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.12
Luminous Opening: Vertical Cylinder (Dia: 1.54' x H: 0.71')
CIE Type: Direct

Input Watts (W): 154.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221382

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

Luminous Intensity Polar Plot

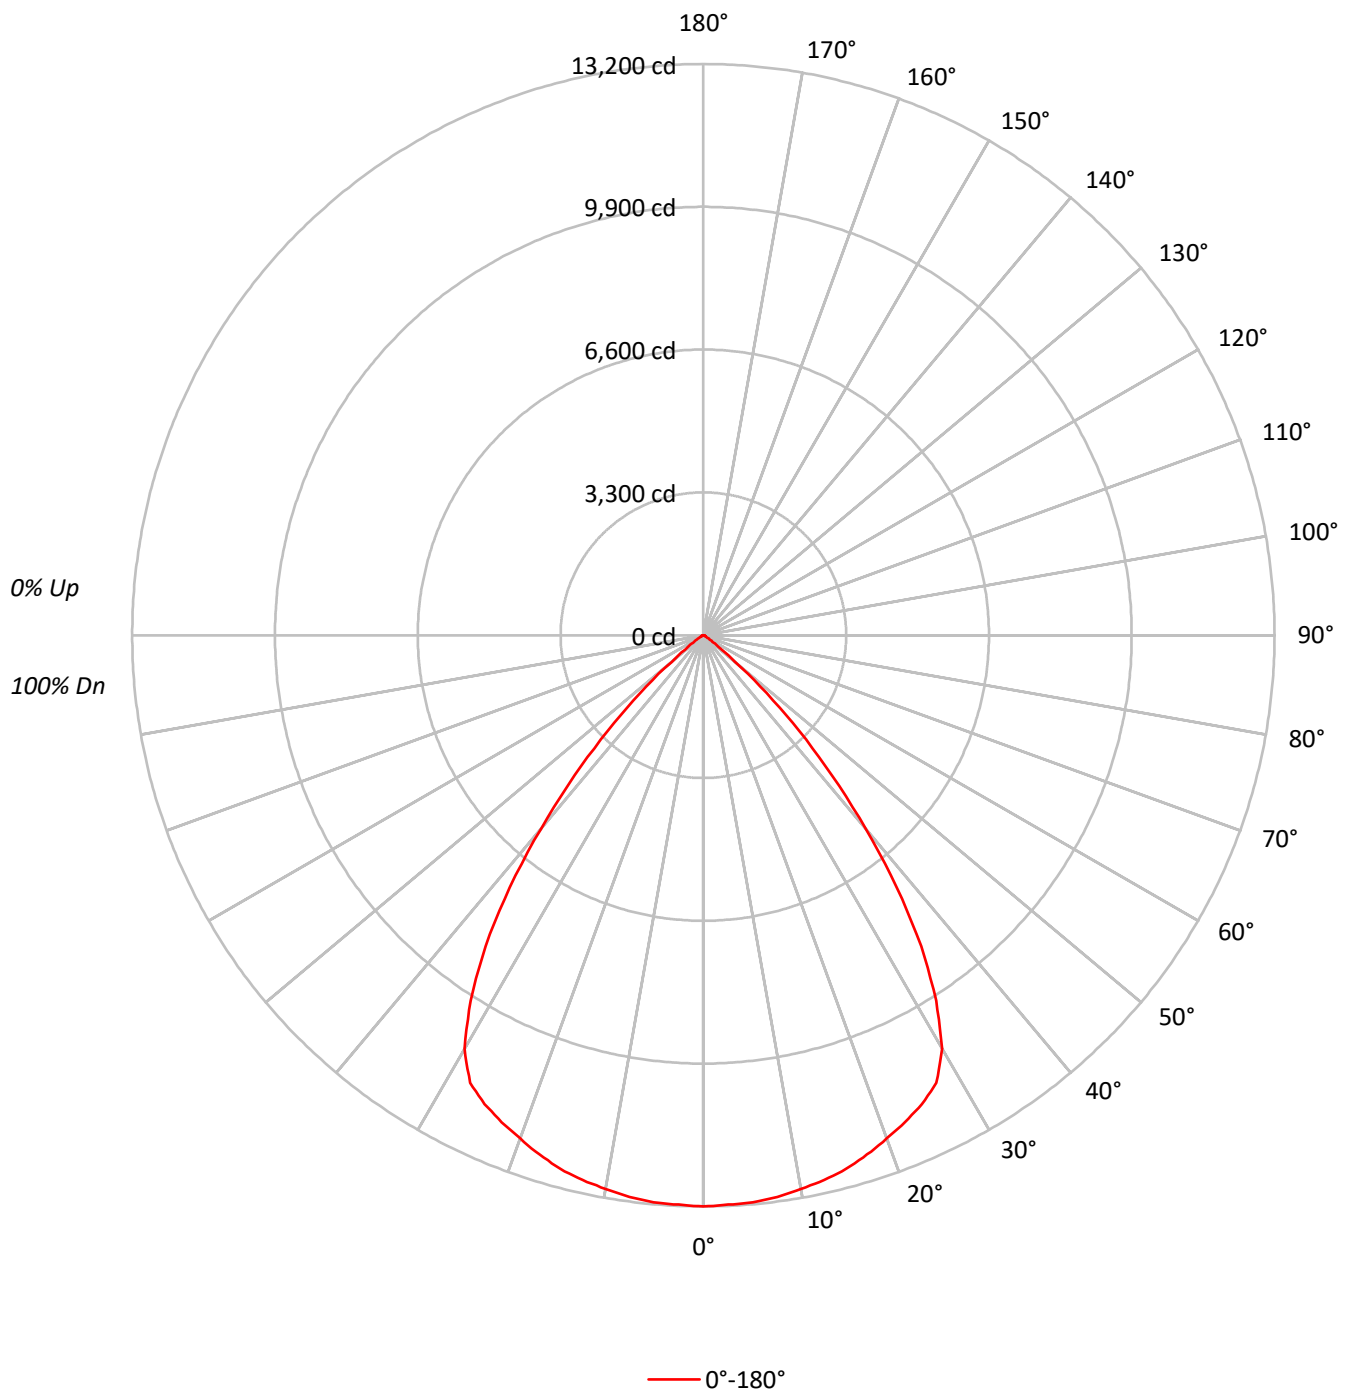

TEST NUMBER: P1221382

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92		
2	107	101	97	93	104	100	95	92	96	93	90	93	90	88	90	88	86	84		
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77		
4	95	86	80	75	93	85	79	75	83	78	74	81	76	73	79	75	72	71		
5	89	80	73	68	87	79	73	68	77	72	67	75	70	67	73	69	66	65		
6	84	74	67	62	82	73	67	62	71	66	62	70	65	61	69	64	61	59		
7	79	69	62	57	77	68	62	57	67	61	57	65	60	56	64	60	56	54		
8	74	64	57	53	73	63	57	52	62	56	52	61	56	52	60	55	52	50		
9	70	60	53	49	69	59	53	48	58	52	48	57	52	48	56	51	48	46		
10	66	56	49	45	65	55	49	45	54	49	45	54	48	45	53	48	44	43		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	76118
5°	72449
10°	68972
15°	65897
20°	62628
25°	59764
30°	54932
35°	43810
40°	29500
45°	16087
50°	5076
55°	1416
60°	364
65°	238
70°	227
75°	211
80°	167
85°	101

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 16087 cd/sqm

TEST NUMBER: P1221382

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1250.7	6.8
10°-20°	3600.8	19.4
20°-30°	5481.3	29.6
30°-40°	5364.8	29.0
40°-50°	2446.8	13.2
50°-60°	292.5	1.6
60°-70°	42.4	0.2
70°-80°	31.1	0.2
80°-90°	12.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10332.7	55.8
0°-40°	15697.6	84.7
0°-60°	18436.8	99.5
0°-90°	18522.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	18522.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13200	
5°	13157	###
15°	12769	3601
25°	11956	5481
35°	8773	5365
45°	3127	2447
55°	258	292
65°	39	42
75°	30	31
85°	12	12
90°	0	

TEST NUMBER: P1221382

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	13200.4
2.5°	13172.0
5°	13156.9
7.5°	13096.7
10°	12994.6
12.5°	12895.9
15°	12768.8
17.5°	12584.8
20°	12379.0
22.5°	12180.7
25°	11955.7
27.5°	11666.3
30°	11036.5
32.5°	10009.3
35°	8772.9
37.5°	7346.8
40°	5842.8
42.5°	4393.2
45°	3126.7
47.5°	1981.6
50°	960.3
52.5°	437.5
55°	258.5
57.5°	126.3
60°	63.6
62.5°	45.2
65°	39.3
67.5°	37.6
70°	35.1
72.5°	32.6
75°	30.1
77.5°	26.8
80°	21.7
82.5°	16.7
85°	11.7
87.5°	5.9
90°	0.0

TEST NUMBER: P1221382

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L24_Medium_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	1.03	0.31	1.34	1.65	0.00	1.03	0.31	1.34	1.65
	3H	0.21	1.16	0.59	1.49	1.86	0.21	1.16	0.59	1.49	1.86
	4H	0.39	1.27	0.80	1.62	2.01	0.39	1.27	0.80	1.62	2.01
	6H	0.56	1.36	0.98	1.73	2.13	0.56	1.36	0.98	1.73	2.13
	8H	0.60	1.35	1.03	1.74	2.15	0.60	1.35	1.03	1.74	2.15
	12H	0.61	1.32	1.04	1.71	2.14	0.61	1.32	1.04	1.71	2.14
4H	2H	0.00	0.68	0.21	1.04	1.42	0.00	0.68	0.21	1.04	1.42
	3H	0.22	0.93	0.64	1.34	1.74	0.22	0.93	0.64	1.34	1.74
	4H	0.50	1.13	0.94	1.56	2.00	0.50	1.13	0.94	1.56	2.00
	6H	0.78	1.32	1.25	1.77	2.24	0.78	1.32	1.25	1.77	2.24
	8H	0.86	1.36	1.33	1.81	2.28	0.86	1.36	1.33	1.81	2.28
	12H	0.89	1.33	1.38	1.82	2.29	0.89	1.33	1.38	1.82	2.29
8H	4H	0.51	1.02	0.99	1.47	1.94	0.51	1.02	0.99	1.47	1.94
	6H	0.87	1.27	1.38	1.77	2.26	0.87	1.27	1.38	1.77	2.26
	8H	0.99	1.35	1.52	1.87	2.37	0.99	1.35	1.52	1.87	2.37
	12H	1.08	1.39	1.60	1.89	2.47	1.08	1.39	1.60	1.89	2.47
12H	4H	0.48	0.92	0.97	1.41	1.88	0.48	0.92	0.97	1.41	1.88
	6H	0.85	1.21	1.38	1.73	2.23	0.85	1.21	1.38	1.73	2.23
	8H	1.01	1.32	1.53	1.82	2.40	1.01	1.32	1.53	1.82	2.40

END OF REPORT