

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221386

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221386
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-22)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 2436 LIGHT ENGINE, BLACK SHADE, NARROW DISTRIBUTION.
LIGHT LEVEL 2 - 32,000 LUMENS
Light Source: 6500K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22231.8 lumens
Efficiency: N/A
Efficacy: 115.1 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 0.98
Luminous Opening: Vertical Cylinder (Dia: 1.54' x H: 0.71')
CIE Type: Direct

Input Watts (W): 193.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221386

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

Luminous Intensity Polar Plot

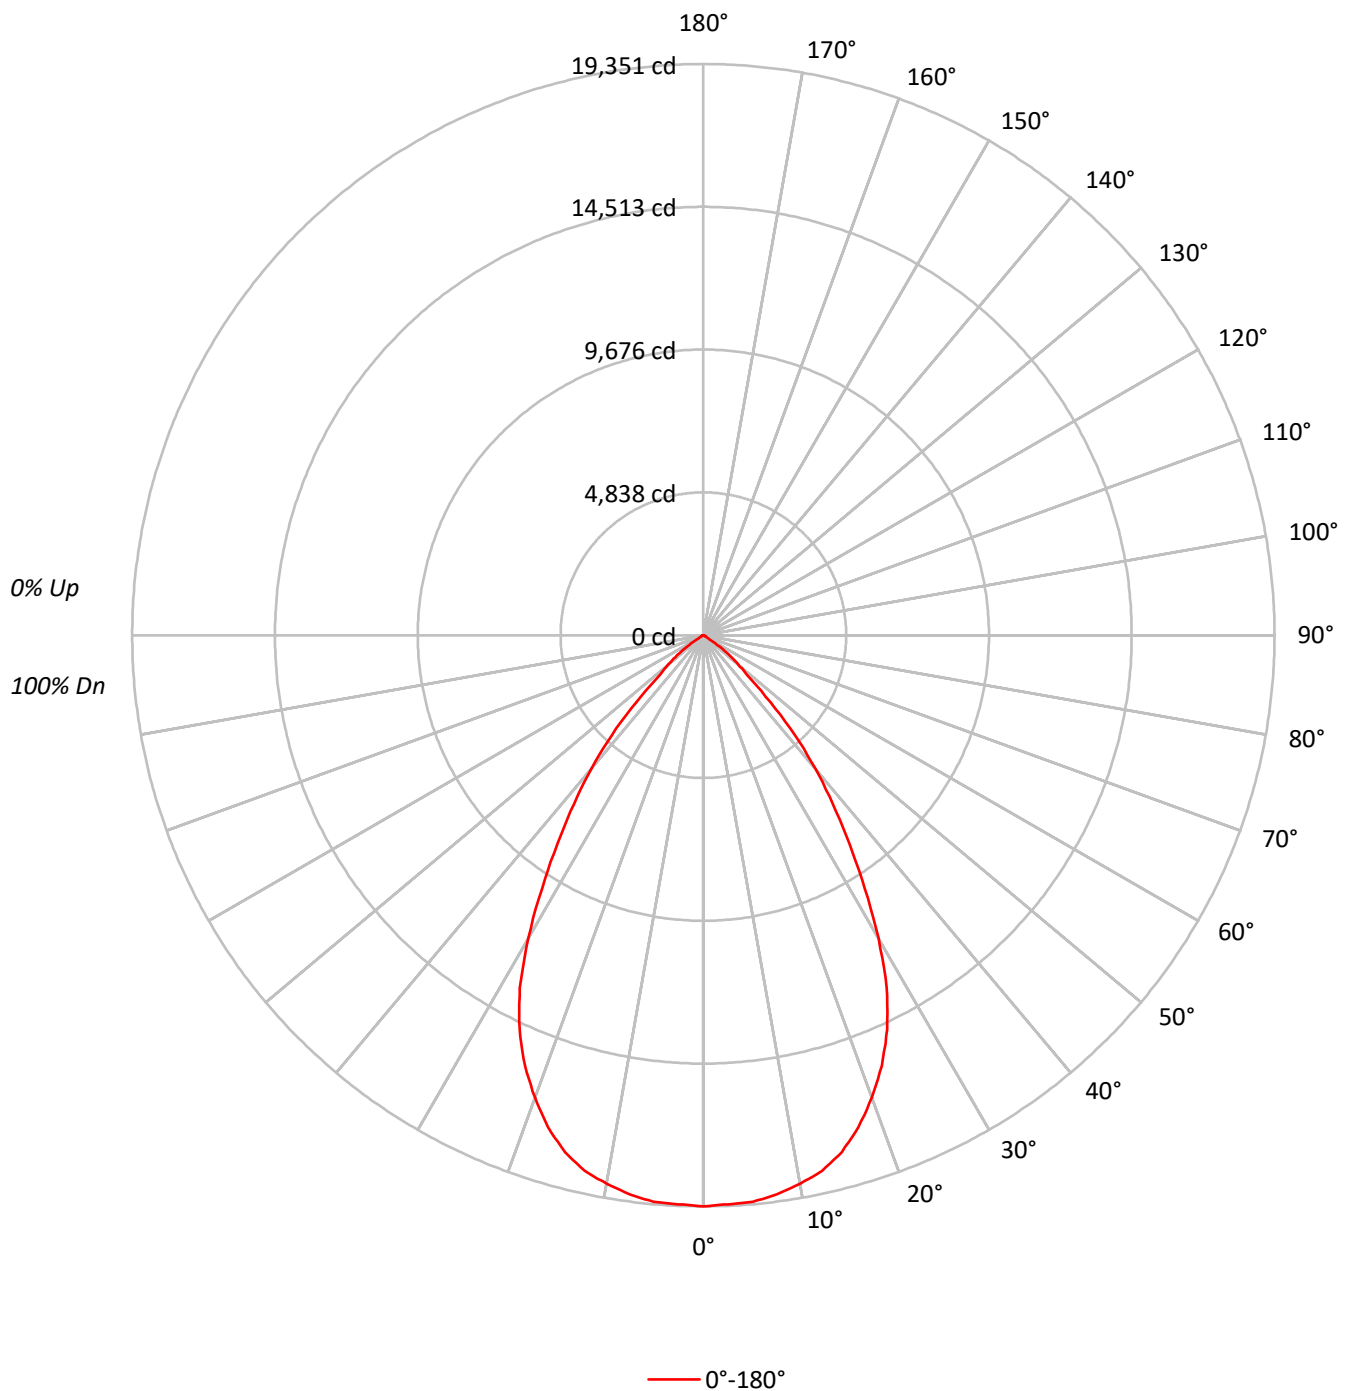

TEST NUMBER: P1221386

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	113	110	107	105	111	108	106	103	104	102	100		100	99	97		93
2	107	102	97	94	105	100	96	93	97	93	91		94	91	89		85
3	101	94	89	84	99	93	88	84	90	86	82		88	84	81		78
4	95	87	81	77	93	86	80	76	84	79	75		82	78	74		72
5	90	81	75	70	88	80	74	70	78	73	69		76	72	68		66
6	85	75	69	64	83	74	68	64	73	68	64		71	67	63		61
7	80	70	64	59	79	70	63	59	68	63	59		67	62	58		57
8	76	66	59	55	75	65	59	55	64	58	54		63	58	54		52
9	72	62	55	51	71	61	55	51	60	54	51		59	54	50		49
10	68	58	52	47	67	57	51	47	56	51	47		56	51	47		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	111582
5°	106085
10°	100165
15°	93556
20°	84395
25°	73674
30°	59052
35°	43008
40°	29705
45°	16495
50°	8216
55°	3120
60°	518
65°	252
70°	236
75°	206
80°	164
85°	96

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 16495 cd/sqm

TEST NUMBER: P1221386

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1825.9	8.2
10°-20°	5068.2	22.8
20°-30°	6677.7	30.0
30°-40°	5401.9	24.3
40°-50°	2566.3	11.5
50°-60°	601.0	2.7
60°-70°	48.0	0.2
70°-80°	30.7	0.1
80°-90°	12.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	13571.8	61.0
0°-40°	18973.7	85.3
0°-60°	22141.1	99.6
0°-90°	22231.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	22231.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19351	
5°	19265	###
15°	18128	5068
25°	14738	6678
35°	8612	5402
45°	3206	2566
55°	570	601
65°	42	48
75°	29	31
85°	11	12
90°	0	

TEST NUMBER: P1221386

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	19350.6
2.5°	19295.8
5°	19265.3
7.5°	19111.0
10°	18871.4
12.5°	18580.0
15°	18128.2
17.5°	17479.5
20°	16681.5
22.5°	15789.1
25°	14738.3
27.5°	13463.2
30°	11864.2
32.5°	10177.8
35°	8612.3
37.5°	7198.1
40°	5883.3
42.5°	4592.0
45°	3206.1
47.5°	1993.9
50°	1554.3
52.5°	1112.7
55°	569.6
57.5°	235.5
60°	90.4
62.5°	50.8
65°	41.6
67.5°	38.6
70°	36.5
72.5°	32.5
75°	29.4
77.5°	25.4
80°	21.3
82.5°	16.2
85°	11.2
87.5°	6.1
90°	0.0

TEST NUMBER: P1221386

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (6500K_L32_Narrow_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	3.58	4.66	3.94	4.97	5.28	3.58	4.66	3.94	4.97	5.28
	3H	3.55	4.49	3.93	4.82	5.19	3.55	4.49	3.93	4.82	5.19
	4H	3.54	4.41	3.95	4.76	5.15	3.54	4.41	3.95	4.76	5.15
	6H	3.52	4.32	3.94	4.69	5.09	3.52	4.32	3.94	4.69	5.09
	8H	3.50	4.25	3.93	4.64	5.05	3.50	4.25	3.93	4.64	5.05
	12H	3.47	4.18	3.90	4.56	4.99	3.47	4.18	3.90	4.56	4.99
4H	2H	3.35	4.22	3.76	4.58	4.96	3.35	4.22	3.76	4.58	4.96
	3H	3.37	4.07	3.78	4.48	4.88	3.37	4.07	3.78	4.48	4.88
	4H	3.39	4.01	3.82	4.43	4.88	3.39	4.01	3.82	4.43	4.88
	6H	3.41	3.95	3.88	4.40	4.87	3.41	3.95	3.88	4.40	4.87
	8H	3.40	3.90	3.87	4.35	4.82	3.40	3.90	3.87	4.35	4.82
	12H	3.37	3.81	3.86	4.29	4.77	3.37	3.81	3.86	4.29	4.77
8H	4H	3.27	3.77	3.75	4.22	4.70	3.27	3.77	3.75	4.22	4.70
	6H	3.33	3.73	3.84	4.23	4.71	3.33	3.73	3.84	4.23	4.71
	8H	3.33	3.69	3.86	4.21	4.70	3.33	3.69	3.86	4.21	4.70
	12H	3.33	3.65	3.85	4.14	4.72	3.33	3.65	3.85	4.14	4.72
12H	4H	3.22	3.66	3.71	4.14	4.62	3.22	3.66	3.71	4.14	4.62
	6H	3.27	3.63	3.80	4.15	4.65	3.27	3.63	3.80	4.15	4.65
	8H	3.30	3.62	3.82	4.11	4.69	3.30	3.62	3.82	4.11	4.69

END OF REPORT