

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504970

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504970
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-79)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)
Description: PrentaLux UHBS2 4-INCH SELECTABLE HIGH BAY 2436 LIGHT ENGINE, DOMIC BLACK SHADE, NARROW DISTRIBUTION
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21484.9 lumens
Efficiency: N/A
Efficacy: 134.4 lumens/watt
Spacing Criteria (0/90/45): 0.99 / 0.99 / 1
Luminous Opening: Circular (Dia: 1.37' x H: 0')
CIE Type: Direct

Input Watts (W): 159.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504970

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)

Luminous Intensity Polar Plot

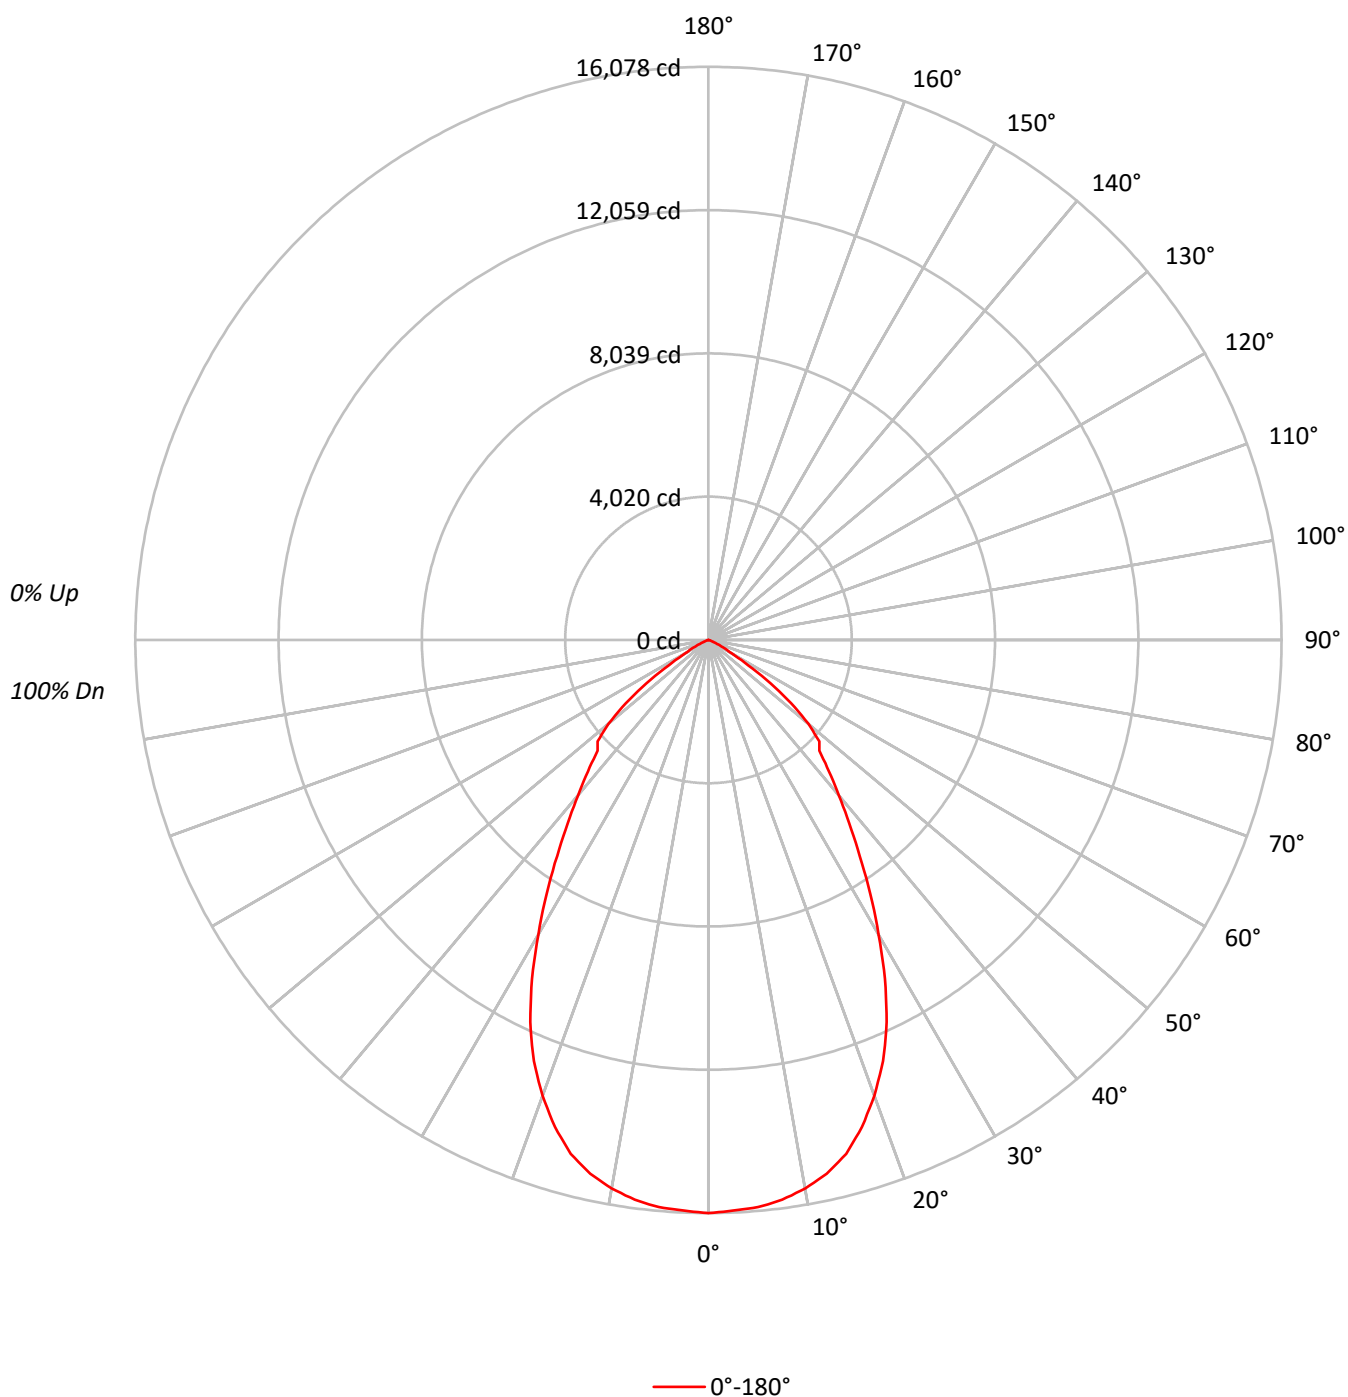



TEST NUMBER: P1504970

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91		
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	86	84	82		
3	99	91	85	81	97	90	84	80	87	82	79	84	81	77	82	79	76	74		
4	93	84	77	72	91	82	76	71	80	75	71	78	73	70	76	72	69	67		
5	87	77	70	65	85	76	69	64	74	68	64	72	67	63	70	66	63	61		
6	81	71	64	59	80	70	63	58	68	62	58	67	62	58	65	61	57	56		
7	76	66	58	54	75	65	58	53	63	57	53	62	57	53	61	56	52	51		
8	72	61	54	49	71	60	54	49	59	53	49	58	52	49	57	52	48	47		
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43		
10	64	53	46	42	63	53	46	42	52	46	42	51	45	42	50	45	41	40		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	117973
5°	117644
10°	116415
15°	113367
20°	106190
25°	95756
30°	80888
35°	66282
40°	54506
45°	45594
50°	41750
55°	27264
60°	10819
65°	5311
70°	1382
75°	408
80°	503
85°	572

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 47.5°

Luminance: 45761 cd/sqm

TEST NUMBER: P1504970

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1513.5	7.0
10°-20°	4165.5	19.4
20°-30°	5372.4	25.0
30°-40°	4653.8	21.7
40°-50°	3520.9	16.4
50°-60°	1895.5	8.8
60°-70°	331.9	1.5
70°-80°	24.5	0.1
80°-90°	6.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	11051.3	51.4
0°-40°	15705.2	73.1
0°-60°	21121.6	98.3
0°-90°	21484.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	21484.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16078	
5°	15972	###
15°	14924	4165
25°	11827	5372
35°	7400	4654
45°	4394	3521
55°	2131	1896
65°	306	332
75°	14	24
85°	7	7
90°	0	

TEST NUMBER: P1504970

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (6500K_L24_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	16077.9
2.5°	16021.1
5°	15972.0
7.5°	15838.9
10°	15624.5
12.5°	15333.0
15°	14923.7
17.5°	14322.1
20°	13599.2
22.5°	12790.8
25°	11827.3
27.5°	10714.7
30°	9546.9
32.5°	8441.9
35°	7399.6
37.5°	6475.9
40°	5690.4
42.5°	5005.7
45°	4393.8
47.5°	4213.3
50°	3657.4
52.5°	2921.9
55°	2131.2
57.5°	1316.9
60°	737.2
62.5°	495.7
65°	305.9
67.5°	152.5
70°	64.4
72.5°	27.1
75°	14.4
77.5°	13.6
80°	11.9
82.5°	9.3
85°	6.8
87.5°	3.4
90°	0.0

(END OF REPORT)