Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: STREETWORKS

Report Number: P981075

Luminaire Tested: **FFX-CLB-80-740-U-FR-T5**

Issue Date: 04/15/2025

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P981075
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	04/15/2025
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	STREETWORKS
Catalog Number:	FFX-CLB-80-740-U-FR-T5
Description:	FAIRFAX POST TOP FIXTURE w/ FAIRFAX REFRACTOR T5 DISTRIBUTION LENS
Light Source:	(6) 4000K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	13405.2 lumens
Efficiency:	N/A
Efficacy:	163.9 lumens/watt
Luminous Opening:	Vertical Cylinder (Dia: 1.17' x H: 1.67')
IES Classification:	Type V - Short
BUG Rating:	B4 - U5 - G3

Input Watts (W):	81.8
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.99
Total Harmonic Distortion (THDi):	6.01%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT




Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

Iso-Footcandle Lines of Horizontal Illumination

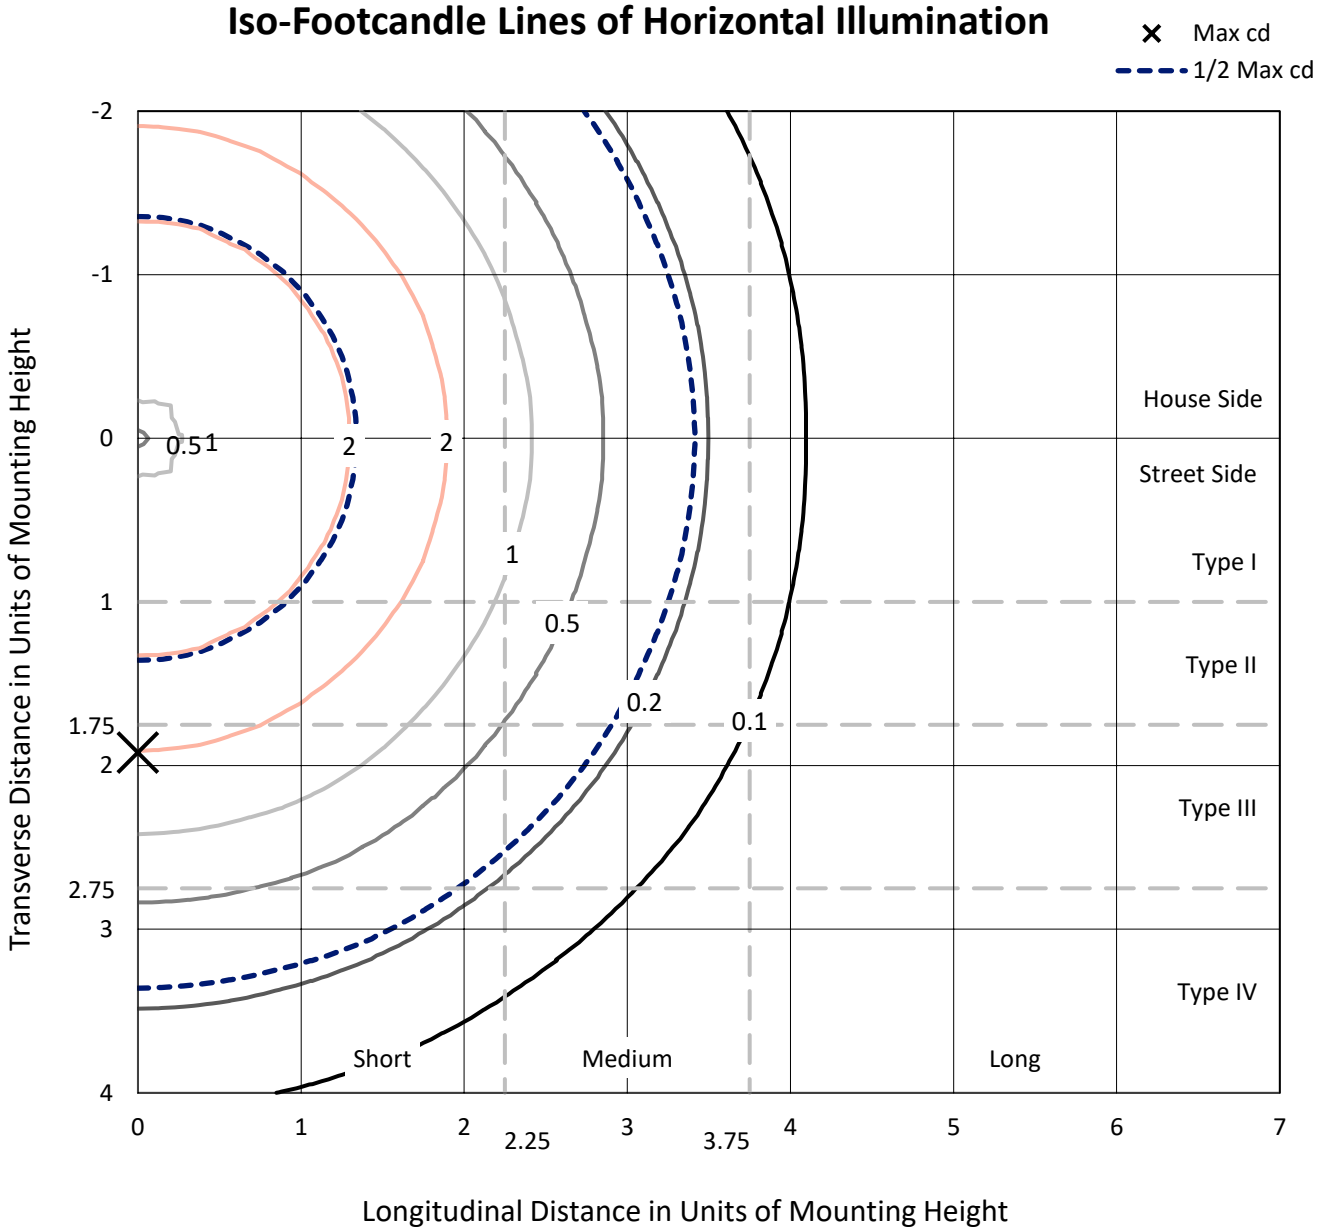


Based on 15 foot mounting height. Maximum calculated value = 2.5 fc
Type V - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

Luminous Intensity Polar Plot

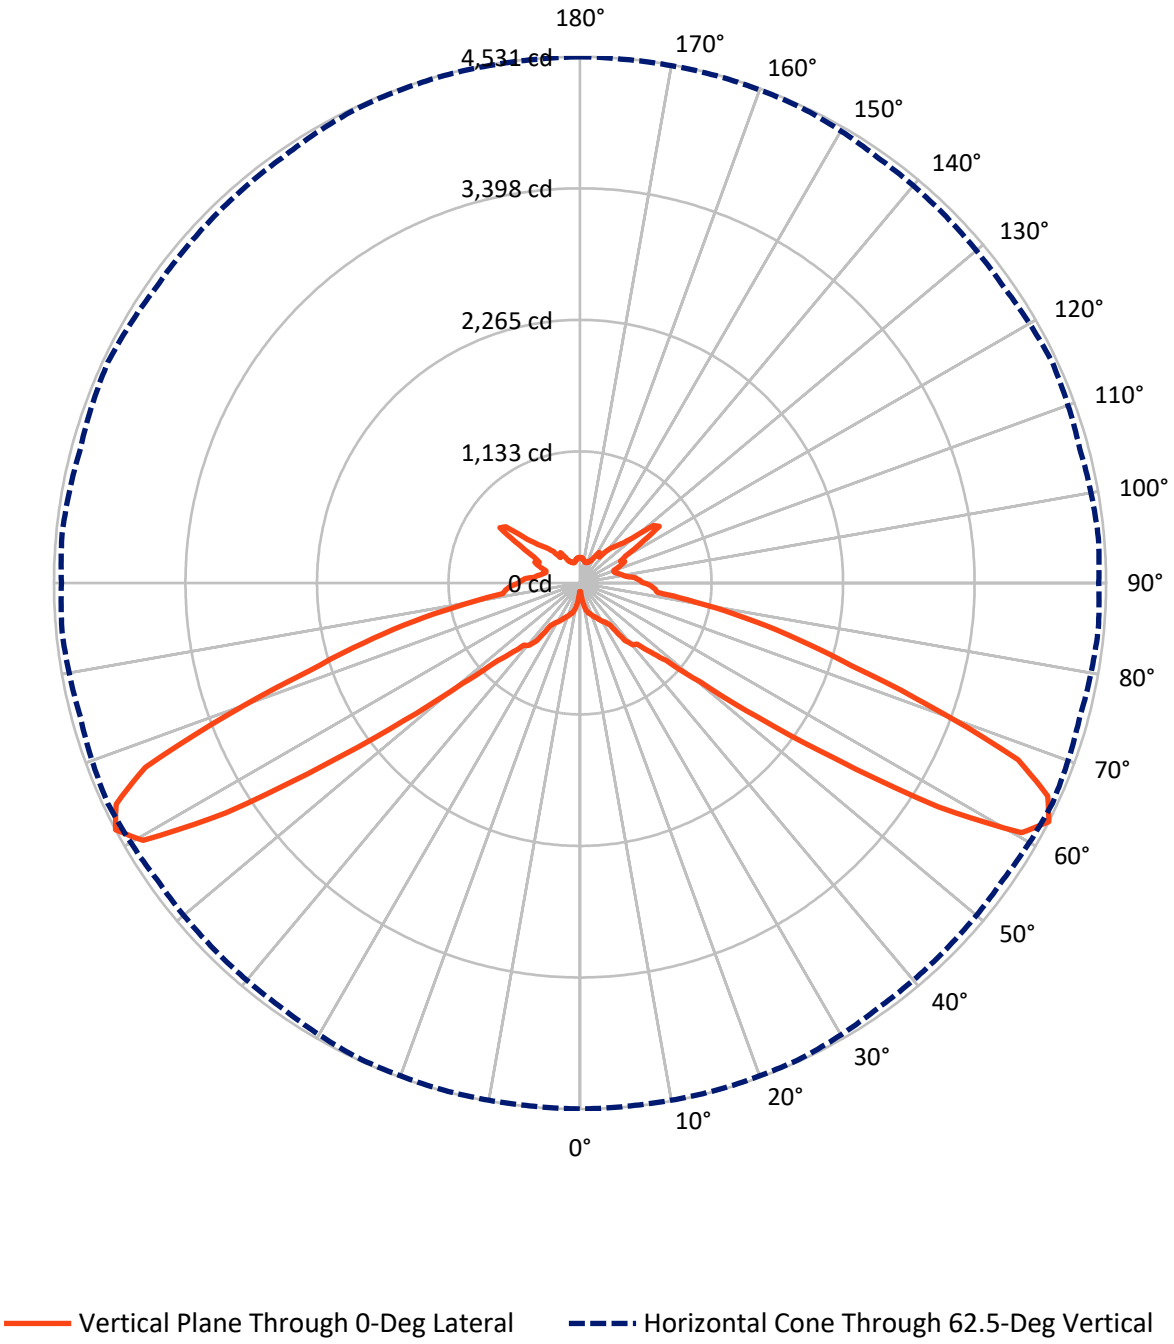

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	5428.7	1273.9	6702.6
	% Fixture	40.5	9.5	50.0
Street Side	Lumens	5428.7	1273.9	6702.6
	% Fixture	40.5	9.5	50.0
Total	Lumens	10857.3	2547.8	13405.2
	% Fixture	81.0	19.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	13.8	0.1
10°-20°	74.5	0.6
20°-30°	158.4	1.2
30°-40°	320.2	2.4
40°-50°	715.4	5.3
50°-60°	2522.9	18.8
60°-70°	4129.0	30.8
70°-80°	2124.1	15.8
80°-90°	799.2	6.0
90°-100°	514.4	3.8
100°-110°	343.1	2.6
110°-120°	368.4	2.7
120°-130°	602.8	4.5
130°-140°	360.8	2.7
140°-150°	187.5	1.4
150°-160°	98.0	0.7
160°-170°	53.0	0.4
170°-180°	19.9	0.1
0°-90°	10857.3	81.0
0°-180°	13405.2	100.0

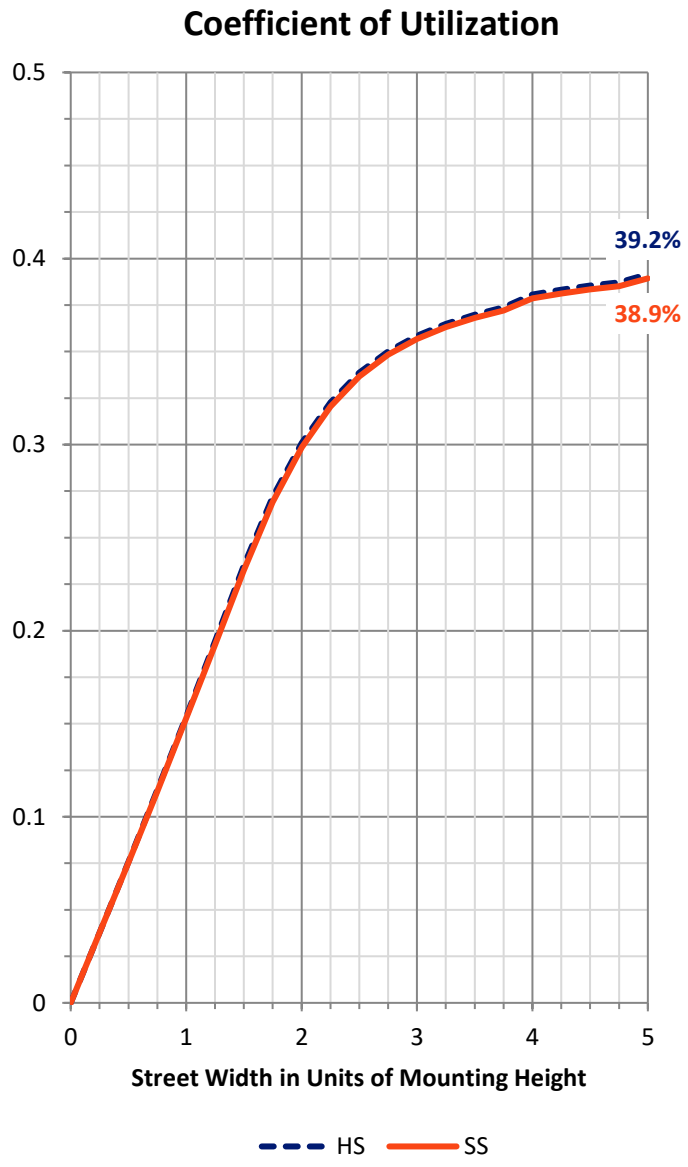

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	123.3	0.9			
FM	(30°-60°)	1779.2	13.3			
FH	(60°-80°)	3126.5	23.3			G2/5000
FVH	(80°-90°)	399.6	3.0			G3/500
BL	(0°-30°)	123.3	0.9	B1/500		
BM	(30°-60°)	1779.2	13.3	B2/2500		
BH	(60°-80°)	3126.5	23.3	B4/5000		G2/5000
BVH	(80°-90°)	399.6	3.0			G3/500
UL	(90°-100°)	514.4	3.8		U4/1000	
UH	(100°-180°)	2033.5	15.2		U5	

BUG Rating: B4-U5-G3
Type V Short

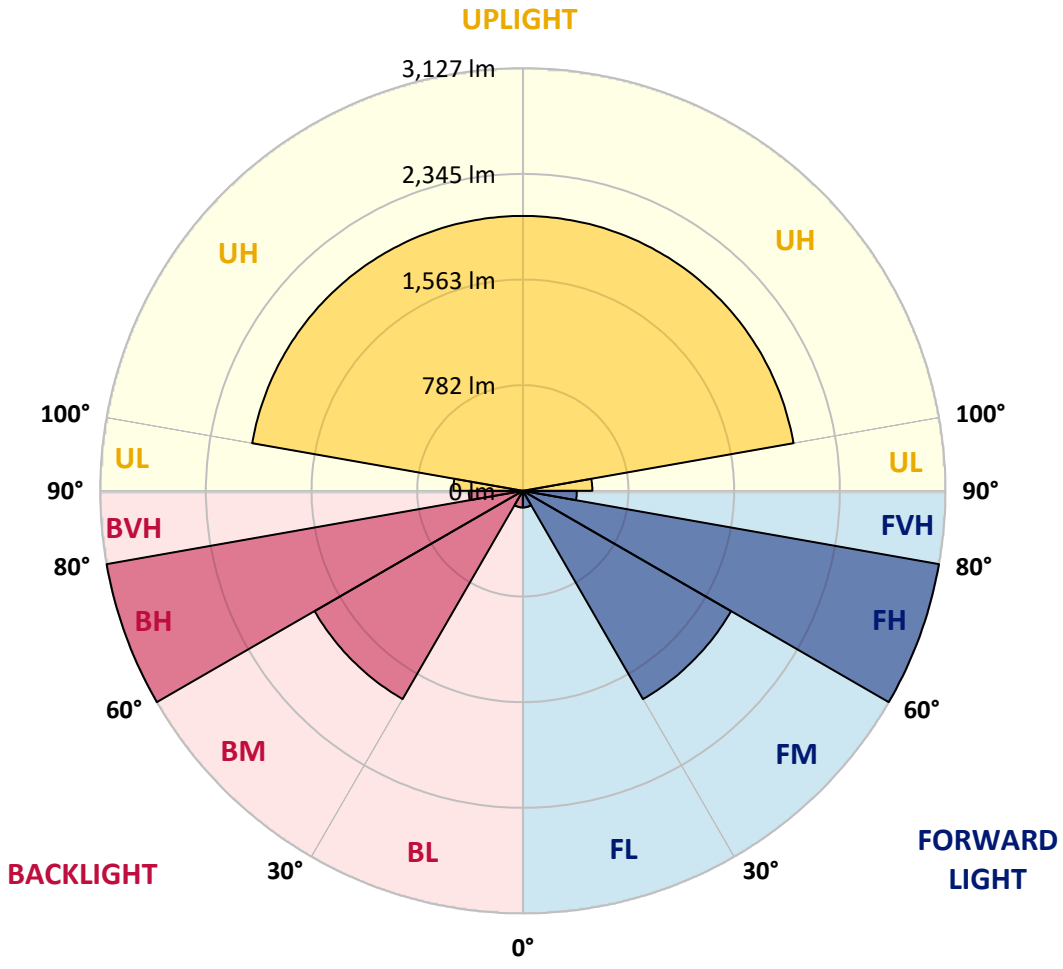

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2	83.2
2.5°	76.4	77.2	79.8	81.5	82.4	80.7	81.5	83.2	83.2	84.1	84.1
5°	113.3	114.1	113.3	112.4	111.5	113.3	114.1	113.3	110.7	111.5	110.7
7.5°	167.3	167.3	160.5	158.7	157.0	164.7	169.0	167.3	158.7	151.0	149.3
10°	205.9	205.1	199.1	191.3	190.5	195.6	206.8	209.4	195.6	186.2	184.5
12.5°	244.6	238.5	235.1	227.4	228.2	231.7	239.4	240.3	230.8	223.1	217.9
15°	267.7	268.6	268.6	264.3	262.6	266.0	269.4	272.0	265.1	259.1	255.7
17.5°	278.0	278.9	281.4	284.0	284.0	282.3	282.3	283.2	283.2	283.2	282.3
20°	299.5	300.3	299.5	301.2	303.8	302.0	299.5	300.3	299.5	300.3	299.5
22.5°	316.6	315.8	315.8	318.3	320.1	319.2	316.6	317.5	315.8	316.6	316.6
25°	334.6	335.5	337.2	338.1	338.9	338.9	338.1	339.8	338.9	337.2	337.2
27.5°	359.5	359.5	359.5	359.5	363.0	363.0	361.2	362.1	359.5	357.8	357.0
30°	383.6	384.4	382.7	384.4	387.8	386.1	385.3	387.0	383.6	382.7	382.7
32.5°	405.9	405.9	405.0	410.2	411.0	409.3	411.9	413.6	415.3	414.4	418.7
35°	443.6	445.3	459.9	472.8	477.1	476.2	479.7	481.4	477.9	477.9	475.4
37.5°	626.4	625.5	604.9	585.2	594.6	606.7	594.6	591.2	584.3	580.9	579.2
40°	699.3	699.3	680.5	682.2	675.3	676.2	680.5	694.2	686.5	672.7	673.6
42.5°	721.6	728.5	750.8	791.1	776.6	753.4	725.9	735.4	755.1	767.1	769.7
45°	848.6	858.1	859.8	858.1	851.2	860.6	853.8	858.9	861.5	876.9	883.8
47.5°	997.9	994.5	995.4	1016.8	1009.1	1015.1	1028.0	1026.3	1037.4	1035.7	1041.7
50°	1337.7	1347.2	1333.4	1360.9	1367.8	1357.5	1407.2	1407.2	1412.4	1390.1	1392.6
52.5°	1922.9	1900.6	1900.6	1907.5	1909.2	1941.0	1976.1	1975.3	1988.2	1976.1	2002.7
55°	2676.3	2671.2	2682.3	2762.1	2770.7	2743.3	2751.0	2715.8	2829.1	2799.9	2821.3
57.5°	3634.8	3647.7	3633.1	3633.9	3627.1	3619.3	3662.2	3589.3	3644.2	3582.4	3584.2
60°	4368.4	4351.3	4303.2	4208.8	4201.1	4229.4	4277.5	4280.1	4225.1	4190.8	4161.6
62.5°	4530.6	4524.6	4522.9	4515.2	4471.4	4459.4	4450.0	4488.6	4456.0	4480.8	4466.3
65°	4426.8	4401.0	4424.2	4461.1	4432.8	4377.0	4329.0	4395.9	4374.4	4467.1	4419.1
67.5°	4067.3	4043.2	4033.8	4106.7	4071.5	3983.2	3950.6	3966.0	3941.1	4043.2	4024.4
70°	3228.1	3228.9	3247.8	3342.2	3307.0	3241.8	3202.3	3212.6	3237.5	3323.3	3299.3
72.5°	2448.9	2443.8	2466.1	2490.1	2491.8	2486.7	2476.4	2484.1	2498.7	2545.9	2557.9
75°	1932.4	1930.7	1894.6	1907.5	1902.3	1925.5	1959.8	1954.7	1962.4	1926.4	1916.1
77.5°	1462.2	1463.9	1450.1	1444.1	1439.0	1476.7	1531.7	1534.2	1497.3	1470.7	1459.6
80°	1011.7	1018.5	1059.7	1060.6	1068.3	1068.3	1112.1	1106.9	1094.0	1093.2	1093.2
82.5°	671.0	683.0	725.1	773.1	780.8	771.4	795.4	802.3	818.6	830.6	834.0
85°	645.3	666.7	653.0	673.6	674.4	680.5	689.9	693.3	691.6	694.2	689.0
87.5°	604.1	630.7	627.2	641.0	644.4	653.8	664.1	668.4	659.9	653.0	651.3
90°	536.3	561.2	573.2	584.3	587.8	585.2	592.1	593.8	592.9	585.2	583.5
92.5°	508.0	517.4	524.3	532.9	543.2	537.2	541.4	537.2	544.0	542.3	544.0
95°	471.9	475.4	471.1	476.2	477.9	471.9	471.1	471.1	467.6	463.4	465.1
97.5°	399.0	405.0	403.3	403.3	404.2	401.6	402.4	401.6	403.3	400.7	399.9
100°	372.4	372.4	370.7	369.8	369.0	366.4	365.5	363.0	363.0	360.4	358.7
102.5°	344.9	347.5	344.9	344.1	344.1	339.8	340.7	340.7	338.9	338.1	333.8
105°	325.2	324.4	322.6	319.2	315.8	315.8	317.5	316.6	314.1	313.2	309.8
107.5°	307.2	305.5	302.9	297.8	296.0	296.9	299.5	300.3	299.5	296.0	293.5
110°	310.6	308.0	303.8	302.0	304.6	306.3	307.2	308.9	314.1	315.8	312.3

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P981075
CATALOG NUMBER: FFX-CLB-80-740-U-FR-T5

CANDELA DISTRIBUTION (continued):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
112.5°	*374.1*	369.8	367.3	356.1	364.7	366.4	364.7	365.5	368.1	364.7	366.4
115°	*427.3*	431.6	432.5	398.1	399.0	393.9	388.7	387.0	379.3	385.3	405.0
117.5°	*394.7*	408.4	378.4	363.0	353.5	350.1	358.7	360.4	352.7	362.1	390.4
120°	*453.1*	459.1	397.3	367.3	366.4	381.0	404.2	411.0	402.4	420.5	453.1
122.5°	*615.2*	610.9	604.9	610.1	596.4	595.5	614.4	611.8	588.6	591.2	598.9
125°	*838.3*	836.6	825.5	814.3	804.9	810.0	802.3	792.9	775.7	773.1	773.1
127.5°	*802.3*	802.3	794.6	788.6	779.1	780.0	779.1	762.0	755.1	756.0	756.0
130°	*590.4*	591.2	615.2	636.7	630.7	633.3	617.8	612.7	635.0	655.6	655.6
132.5°	*500.3*	502.0	528.6	544.9	536.3	519.1	502.8	504.5	518.3	538.9	538.0
135°	*447.1*	450.5	452.2	450.5	445.3	441.0	440.2	444.5	447.9	462.5	465.9
137.5°	*405.0*	402.4	393.9	386.1	380.1	391.3	398.1	396.4	393.0	390.4	392.1
140°	*356.1*	352.7	340.7	338.9	342.4	347.5	349.2	351.0	351.8	350.1	349.2
142.5°	*278.0*	280.6	291.7	305.5	306.3	297.8	298.6	298.6	302.0	306.3	304.6
145°	*278.9*	280.6	284.9	295.2	295.2	288.3	285.7	288.3	296.0	304.6	304.6
147.5°	*310.6*	308.0	302.0	299.5	296.9	296.0	296.0	290.0	290.9	290.9	290.9
150°	*264.3*	263.4	260.0	258.3	257.4	256.6	260.9	260.0	261.7	260.0	259.1
152.5°	*217.9*	217.1	213.7	211.1	211.9	217.1	224.0	226.5	224.8	221.4	219.7
155°	*206.8*	207.7	202.5	200.8	201.6	204.2	205.9	205.9	202.5	198.2	198.2
157.5°	*195.6*	196.5	193.9	192.2	193.1	194.8	197.4	198.2	195.6	192.2	191.3
160°	*187.1*	186.2	185.3	185.3	185.3	185.3	186.2	187.1	186.2	185.3	184.5
162.5°	*182.8*	182.8	182.8	182.8	183.6	182.8	182.8	182.8	182.8	182.8	182.8
165°	*181.9*	181.9	182.8	184.5	185.3	184.5	184.5	184.5	185.3	187.1	187.1
167.5°	*189.6*	188.8	191.3	192.2	193.1	192.2	191.3	190.5	191.3	193.1	193.1
170°	*198.2*	199.1	199.1	199.9	199.9	199.1	198.2	199.1	198.2	199.1	199.1
172.5°	*206.8*	206.8	206.8	205.9	205.9	205.9	205.9	205.9	205.9	205.1	205.1
175°	*213.7*	213.7	213.7	213.7	212.8	213.7	214.5	214.5	213.7	213.7	211.9
177.5°	*219.7*	219.7	219.7	219.7	219.7	219.7	219.7	218.8	218.8	218.8	217.9
180°	*220.5*	220.5	220.5	220.5	220.5	220.5	220.5	220.5	220.5	220.5	220.5

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Streetworks

Report Number: SP1-2501-332-1

Test Date: 03/20/2025

Luminaire Tested: FFX-CLB-100-740-U-FR-T5

Data in this report applies to families of products including FFX-CLB-100-740-U-FR-T5

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2501-332-1
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	03/31/2025
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Streetworks
Catalog Number:	**FFX-CLB-100-740-U-FR-T5**
Description:	FAIRFAX ACORN W/ FAIRFAX REFRACTOR 100W T5

Spectral Parameters

CCT (K):	3990	CRI (Ra):	73.9		
CIE u':	0.2247	R1:	69.6	R9:	-36.4
CIE v':	0.5031	R2:	83.0	R10:	60.9
Duv:	0.0011	R3:	93.1	R11:	66.8
CIE x:	0.3816	R4:	70.6	R12:	52.5
CIE y:	0.3798	R5:	70.6	R13:	72.5
CIE z:	0.2386	R6:	76.4	R14:	96.4
Peak Wavelength (nm):	450	R7:	79.8	R15:	61.3
Dominant Wavelength (nm):	578	R8:	48.1		
Purity:	28.50862				

Rf:	77.5
Rg:	91.9

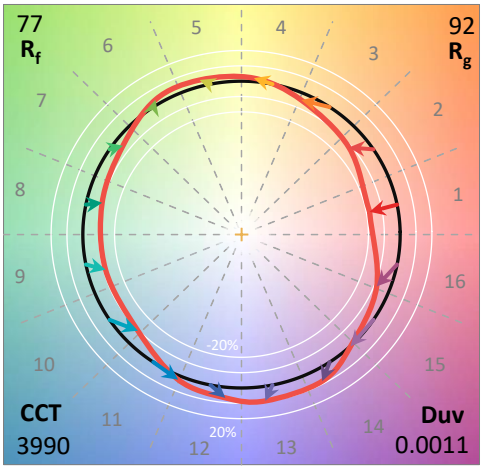


Test Conditions

Stabilization Time:	70M
Operation Time:	2H 10M
Sphere Temperature (°C):	25.0


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	12/16/2024	6/16/2025
Power Meter	INXT2011004	1/21/2025	1/21/2026
AC Power Source	IN0063	10/22/2024	10/22/2025
DC Power Source	IN0208	10/22/2024	10/22/2025
Sphere Thermometer	IN0085	10/22/2024	10/22/2025
Room Thermometer	IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2501-332-1

CIE 1931 Chromaticity Diagram

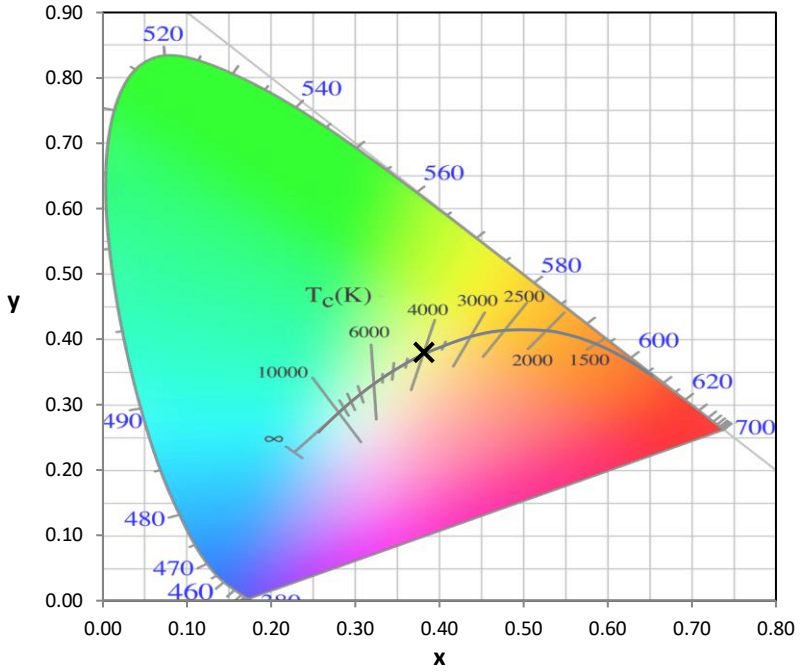

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

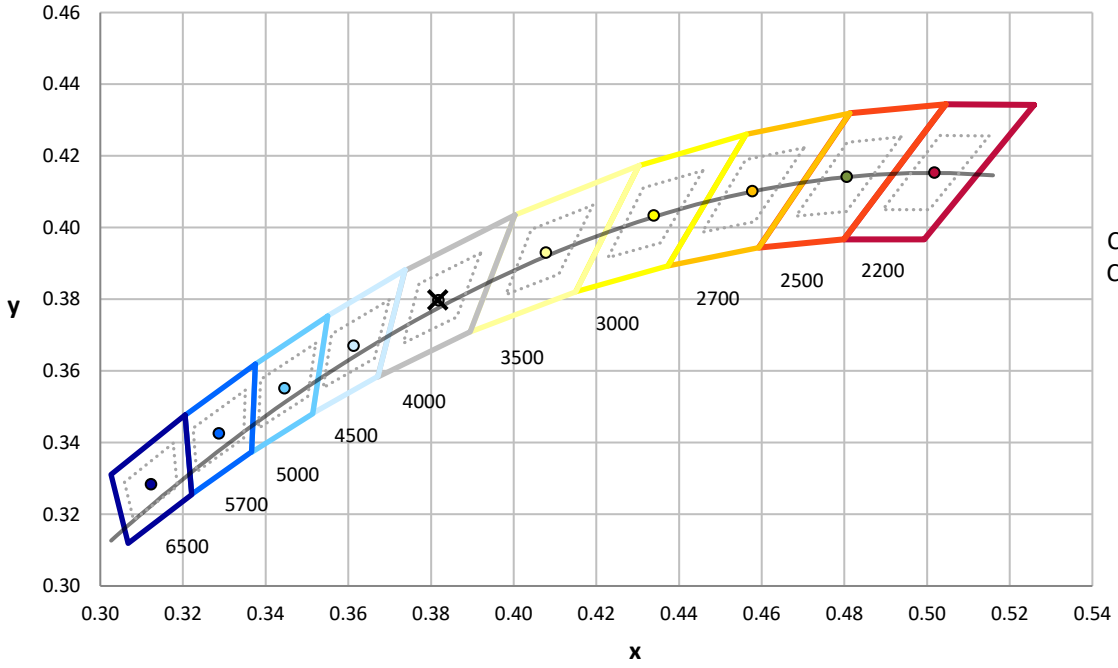


CCT = 3990K
CIE x = 0.3816
CIE y = 0.3798
Duv = 0.0011

Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2501-332-1

Photopic Flux vs. Wavelength

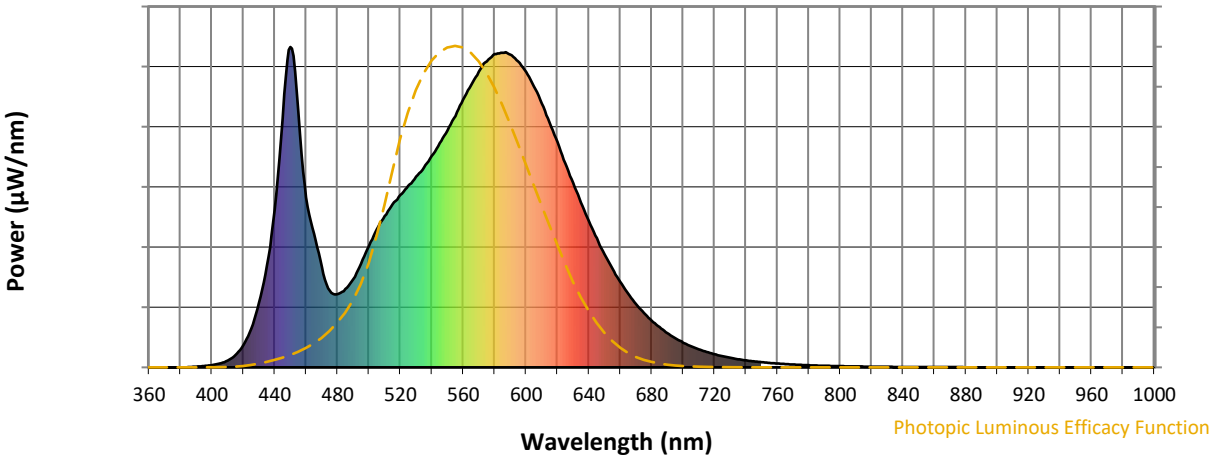


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	275	NR	620	703	NR	750	16	NR	880	1	NR
365	0	NR	495	324	NR	625	637	NR	755	14	NR	885	0	NR
370	0	NR	500	380	NR	630	576	NR	760	12	NR	890	0	NR
375	0	NR	505	431	NR	635	514	NR	765	10	NR	895	0	NR
380	0	NR	510	472	NR	640	456	NR	770	9	NR	900	0	NR
385	1	NR	515	508	NR	645	403	NR	775	8	NR	905	0	NR
390	2	NR	520	538	NR	650	353	NR	780	7	NR	910	0	NR
395	4	NR	525	567	NR	655	307	NR	785	6	NR	915	0	NR
400	7	NR	530	595	NR	660	266	NR	790	5	NR	920	0	NR
405	12	NR	535	624	NR	665	230	NR	795	4	NR	925	0	NR
410	21	NR	540	660	NR	670	198	NR	800	4	NR	930	0	NR
415	39	NR	545	700	NR	675	170	NR	805	3	NR	935	0	NR
420	69	NR	550	739	NR	680	146	NR	810	3	NR	940	0	NR
425	121	NR	555	784	NR	685	125	NR	815	3	NR	945	0	NR
430	202	NR	560	836	NR	690	107	NR	820	2	NR	950	0	NR
435	319	NR	565	881	NR	695	91	NR	825	2	NR	955	0	NR
440	492	NR	570	923	NR	700	77	NR	830	2	NR	960	0	NR
445	777	NR	575	955	NR	705	66	NR	835	1	NR	965	0	NR
450	1000	NR	580	978	NR	710	56	NR	840	1	NR	970	0	NR
455	797	NR	585	982	NR	715	48	NR	845	1	NR	975	0	NR
460	530	NR	590	976	NR	720	41	NR	850	1	NR	980	0	NR
465	418	NR	595	955	NR	725	35	NR	855	1	NR	985	0	NR
470	311	NR	600	922	NR	730	30	NR	860	1	NR	990	0	NR
475	239	NR	605	877	NR	735	25	NR	865	1	NR	995	0	NR
480	229	NR	610	823	NR	740	22	NR	870	1	NR	1000	0	NR
485	245	NR	615	764	NR	745	19	NR	875	1	NR			

REPORT NUMBER: SP1-2501-332-1

Scotopic Flux vs. Wavelength

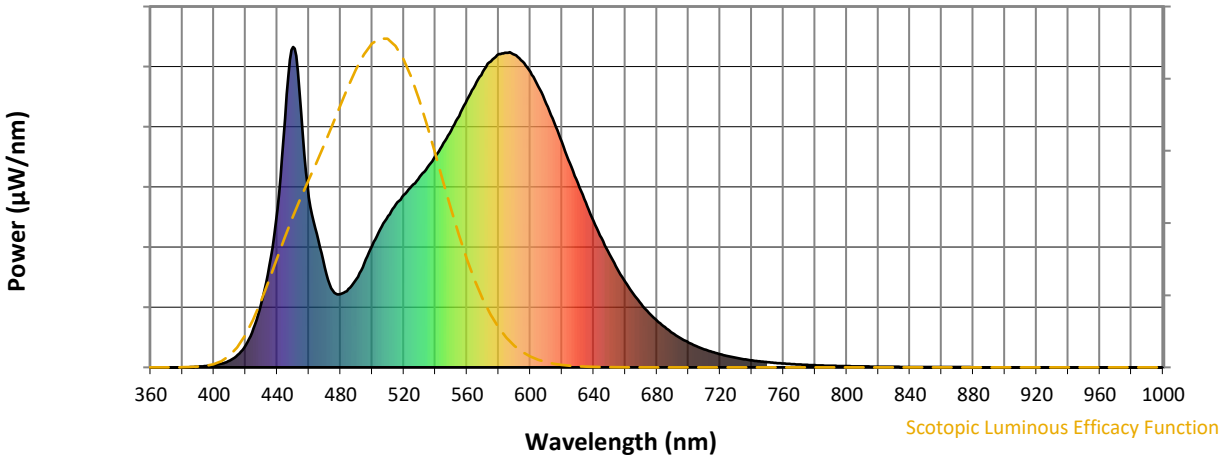


Scotopic Lumens: NR **S/P: 1.59**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	275	NR	620	703	NR	750	16	NR	880	1	NR
365	0	NR	495	324	NR	625	637	NR	755	14	NR	885	0	NR
370	0	NR	500	380	NR	630	576	NR	760	12	NR	890	0	NR
375	0	NR	505	431	NR	635	514	NR	765	10	NR	895	0	NR
380	0	NR	510	472	NR	640	456	NR	770	9	NR	900	0	NR
385	1	NR	515	508	NR	645	403	NR	775	8	NR	905	0	NR
390	2	NR	520	538	NR	650	353	NR	780	7	NR	910	0	NR
395	4	NR	525	567	NR	655	307	NR	785	6	NR	915	0	NR
400	7	NR	530	595	NR	660	266	NR	790	5	NR	920	0	NR
405	12	NR	535	624	NR	665	230	NR	795	4	NR	925	0	NR
410	21	NR	540	660	NR	670	198	NR	800	4	NR	930	0	NR
415	39	NR	545	700	NR	675	170	NR	805	3	NR	935	0	NR
420	69	NR	550	739	NR	680	146	NR	810	3	NR	940	0	NR
425	121	NR	555	784	NR	685	125	NR	815	3	NR	945	0	NR
430	202	NR	560	836	NR	690	107	NR	820	2	NR	950	0	NR
435	319	NR	565	881	NR	695	91	NR	825	2	NR	955	0	NR
440	492	NR	570	923	NR	700	77	NR	830	2	NR	960	0	NR
445	777	NR	575	955	NR	705	66	NR	835	1	NR	965	0	NR
450	1000	NR	580	978	NR	710	56	NR	840	1	NR	970	0	NR
455	797	NR	585	982	NR	715	48	NR	845	1	NR	975	0	NR
460	530	NR	590	976	NR	720	41	NR	850	1	NR	980	0	NR
465	418	NR	595	955	NR	725	35	NR	855	1	NR	985	0	NR
470	311	NR	600	922	NR	730	30	NR	860	1	NR	990	0	NR
475	239	NR	605	877	NR	735	25	NR	865	1	NR	995	0	NR
480	229	NR	610	823	NR	740	22	NR	870	1	NR	1000	0	NR
485	245	NR	615	764	NR	745	19	NR	875	1	NR			

REPORT NUMBER: SP1-2501-332-1

Melanopic Flux vs. Wavelength

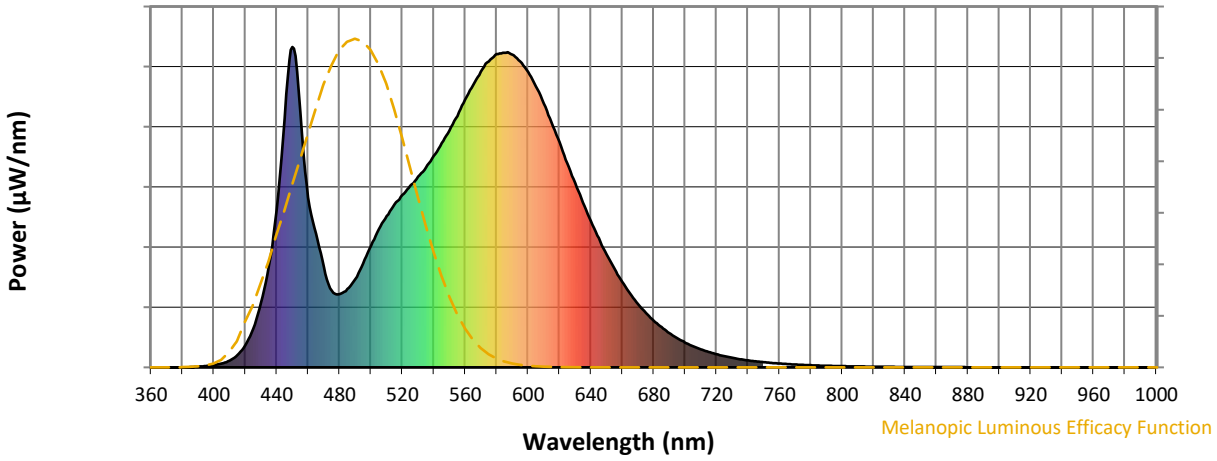

Melanopic Lumens: NR **M/P: 3.21**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	275	NR	620	703	NR	750	16	NR	880	1	NR
365	0	NR	495	324	NR	625	637	NR	755	14	NR	885	0	NR
370	0	NR	500	380	NR	630	576	NR	760	12	NR	890	0	NR
375	0	NR	505	431	NR	635	514	NR	765	10	NR	895	0	NR
380	0	NR	510	472	NR	640	456	NR	770	9	NR	900	0	NR
385	1	NR	515	508	NR	645	403	NR	775	8	NR	905	0	NR
390	2	NR	520	538	NR	650	353	NR	780	7	NR	910	0	NR
395	4	NR	525	567	NR	655	307	NR	785	6	NR	915	0	NR
400	7	NR	530	595	NR	660	266	NR	790	5	NR	920	0	NR
405	12	NR	535	624	NR	665	230	NR	795	4	NR	925	0	NR
410	21	NR	540	660	NR	670	198	NR	800	4	NR	930	0	NR
415	39	NR	545	700	NR	675	170	NR	805	3	NR	935	0	NR
420	69	NR	550	739	NR	680	146	NR	810	3	NR	940	0	NR
425	121	NR	555	784	NR	685	125	NR	815	3	NR	945	0	NR
430	202	NR	560	836	NR	690	107	NR	820	2	NR	950	0	NR
435	319	NR	565	881	NR	695	91	NR	825	2	NR	955	0	NR
440	492	NR	570	923	NR	700	77	NR	830	2	NR	960	0	NR
445	777	NR	575	955	NR	705	66	NR	835	1	NR	965	0	NR
450	1000	NR	580	978	NR	710	56	NR	840	1	NR	970	0	NR
455	797	NR	585	982	NR	715	48	NR	845	1	NR	975	0	NR
460	530	NR	590	976	NR	720	41	NR	850	1	NR	980	0	NR
465	418	NR	595	955	NR	725	35	NR	855	1	NR	985	0	NR
470	311	NR	600	922	NR	730	30	NR	860	1	NR	990	0	NR
475	239	NR	605	877	NR	735	25	NR	865	1	NR	995	0	NR
480	229	NR	610	823	NR	740	22	NR	870	1	NR	1000	0	NR
485	245	NR	615	764	NR	745	19	NR	875	1	NR			


REPORT NUMBER: SP1-2501-332-1

TM-30-18


Summary


R_f = 77.5
R_g = 91.9
CIE R_a = 73.9
R_9 = -36.4


Spectral Power Distribution Comparison

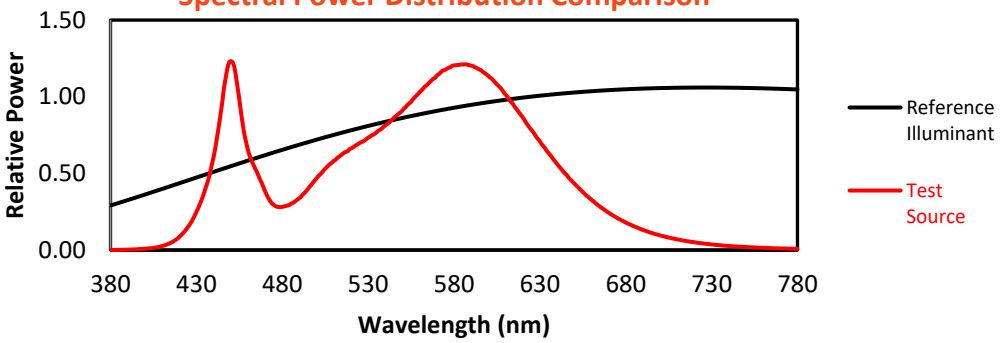


Color Vector Graphics

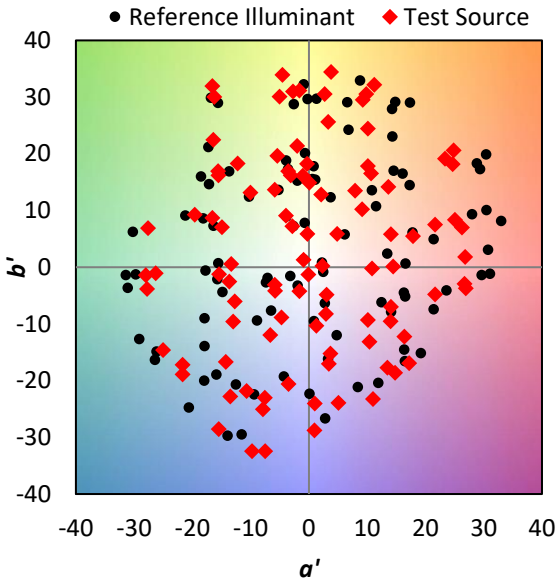

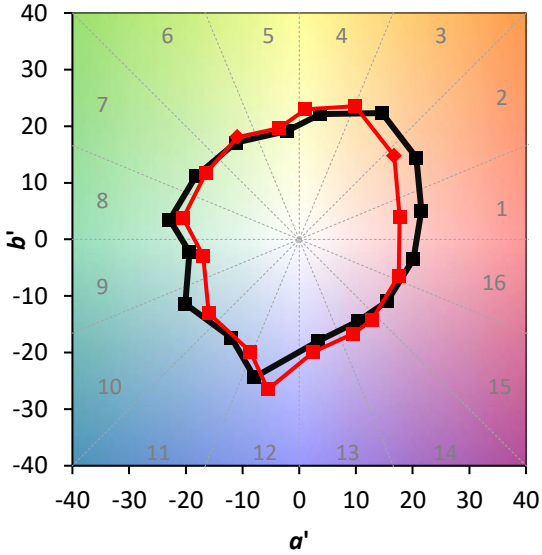

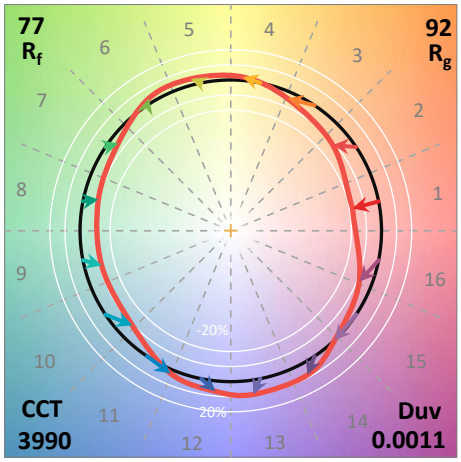

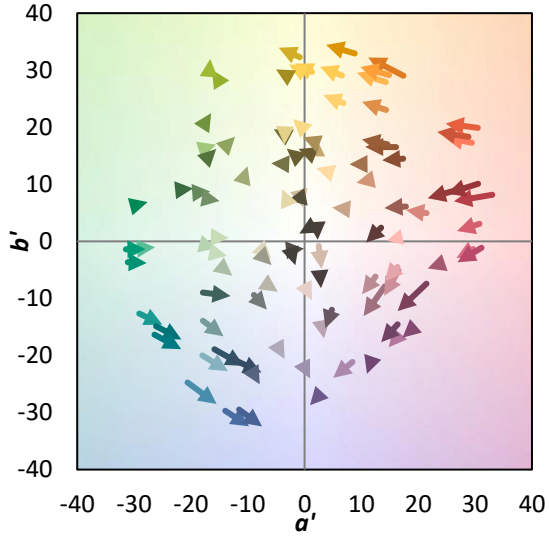


REPORT NUMBER: SP1-2501-332-1

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 72	CES51 = 89	CES76 = 64
CES02 = 61	CES27 = 92	CES52 = 88	CES77 = 77
CES03 = 30	CES28 = 88	CES53 = 81	CES78 = 65
CES04 = 70	CES29 = 78	CES54 = 85	CES79 = 88
CES05 = 47	CES30 = 92	CES55 = 84	CES80 = 86
CES06 = 50	CES31 = 81	CES56 = 77	CES81 = 77
CES07 = 40	CES32 = 72	CES57 = 76	CES82 = 94
CES08 = 39	CES33 = 87	CES58 = 77	CES83 = 94
CES09 = 29	CES34 = 80	CES59 = 86	CES84 = 87
CES10 = 74	CES35 = 89	CES60 = 89	CES85 = 76
CES11 = 57	CES36 = 87	CES61 = 82	CES86 = 68
CES12 = 63	CES37 = 87	CES62 = 85	CES87 = 78
CES13 = 42	CES38 = 98	CES63 = 79	CES88 = 81
CES14 = 74	CES39 = 98	CES64 = 68	CES89 = 71
CES15 = 71	CES40 = 94	CES65 = 67	CES90 = 81
CES16 = 46	CES41 = 98	CES66 = 65	CES91 = 73
CES17 = 49	CES42 = 91	CES67 = 62	CES92 = 55
CES18 = 56	CES43 = 86	CES68 = 69	CES93 = 73
CES19 = 72	CES44 = 99	CES69 = 76	CES94 = 51
CES20 = 65	CES45 = 89	CES70 = 64	CES95 = 65
CES21 = 86	CES46 = 86	CES71 = 59	CES96 = 77
CES22 = 78	CES47 = 93	CES72 = 86	CES97 = 85
CES23 = 92	CES48 = 79	CES73 = 56	CES98 = 77
CES24 = 91	CES49 = 85	CES74 = 93	CES99 = 63
CES25 = 72	CES50 = 89	CES75 = 63	

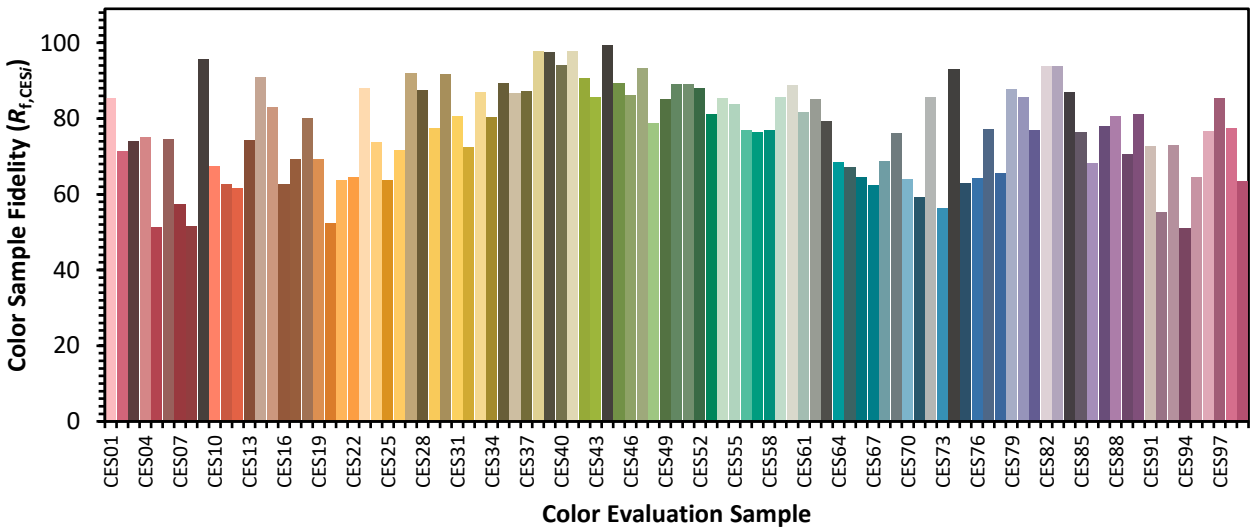



REPORT NUMBER: SP1-2501-332-1

TM-30-18

Color Rendition by Hue-Angle Bin

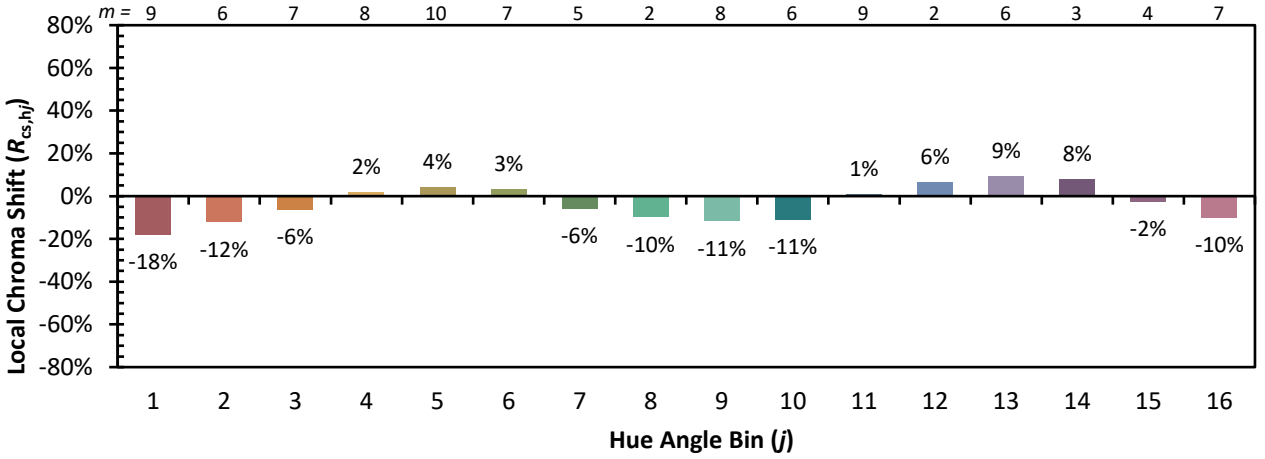

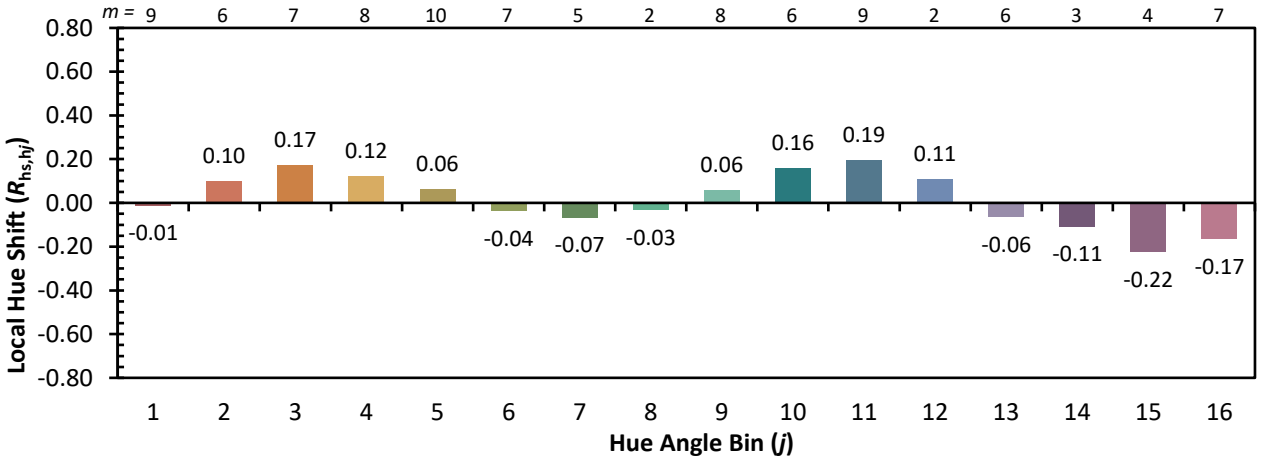


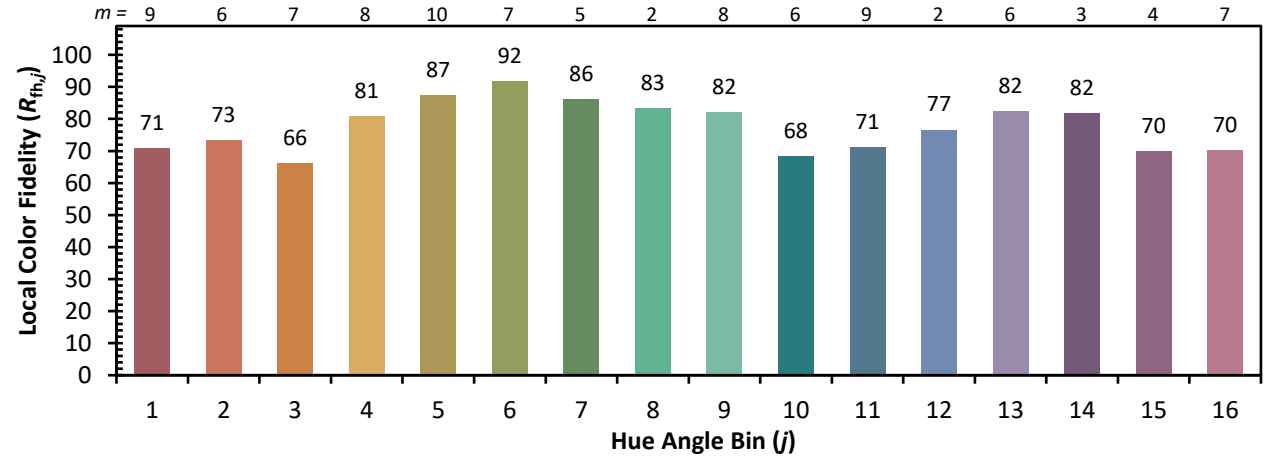


REPORT NUMBER: SP1-2501-332-1

TM-30-18

Measure Comparisons

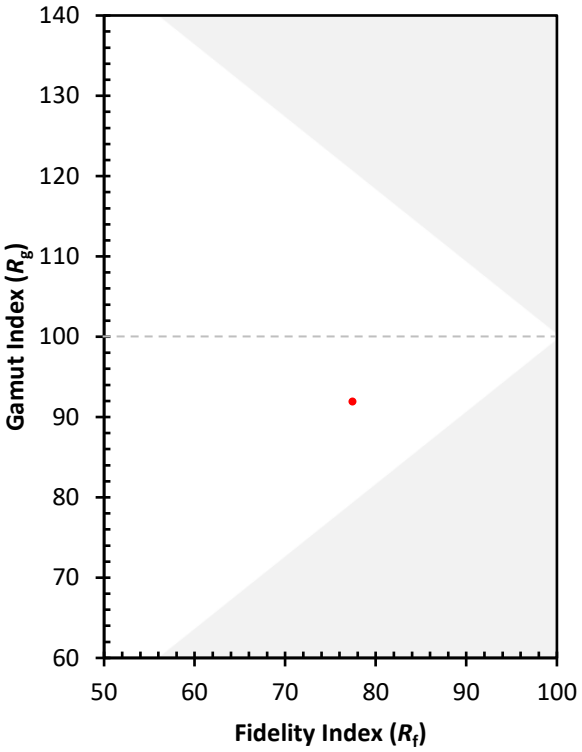

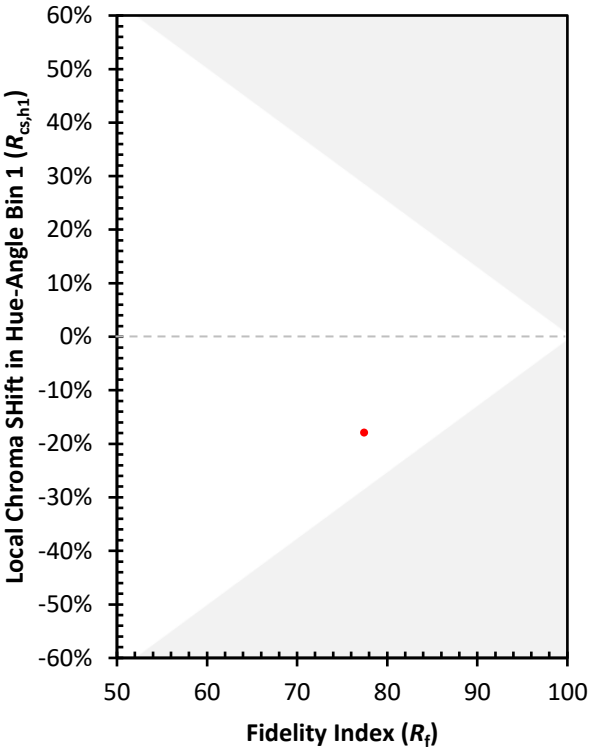

(END OF REPORT)